





Prolunghe di verifica dei circuiti ausiliari ad interruttore estratto T4-T5

Extensions to test the auxiliary circuits with the circuit breaker racked-out T4-T5


Prüfverlängerungen für Kontrolle der Hilfsstromkreise bei ausgefahrenem Leistungsschalter T4-T5

Rallonges de vérification des circuits auxiliaires avec disjoncteur débroché T4-T5


Prolongaciones para controlar los circuitos auxiliares con interruptor extraído T4-T5

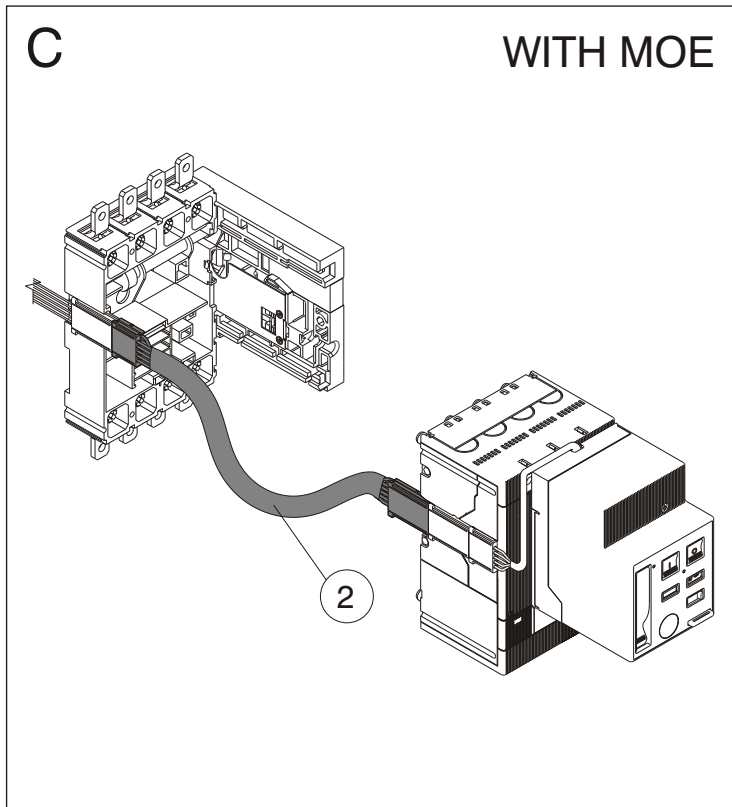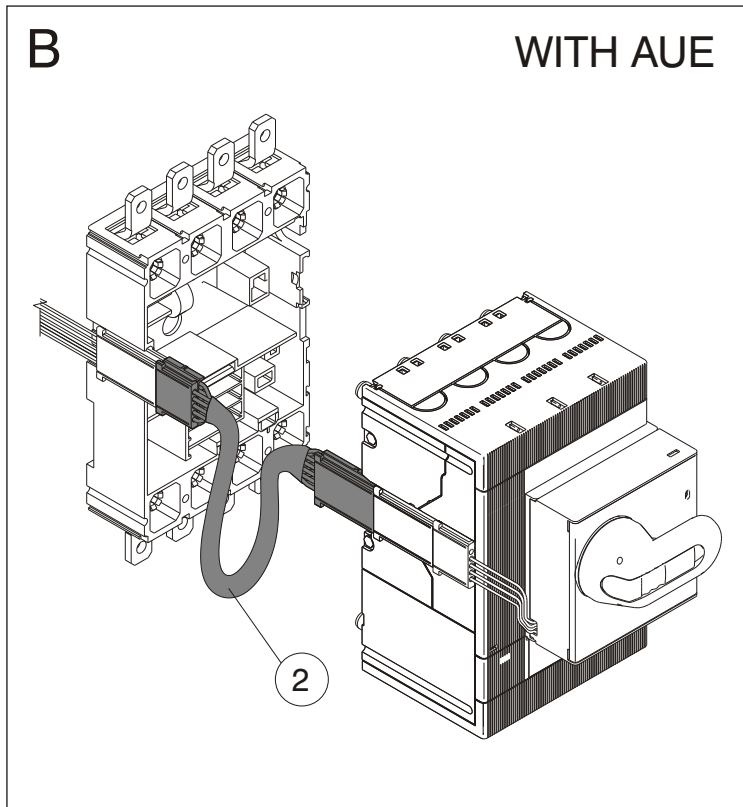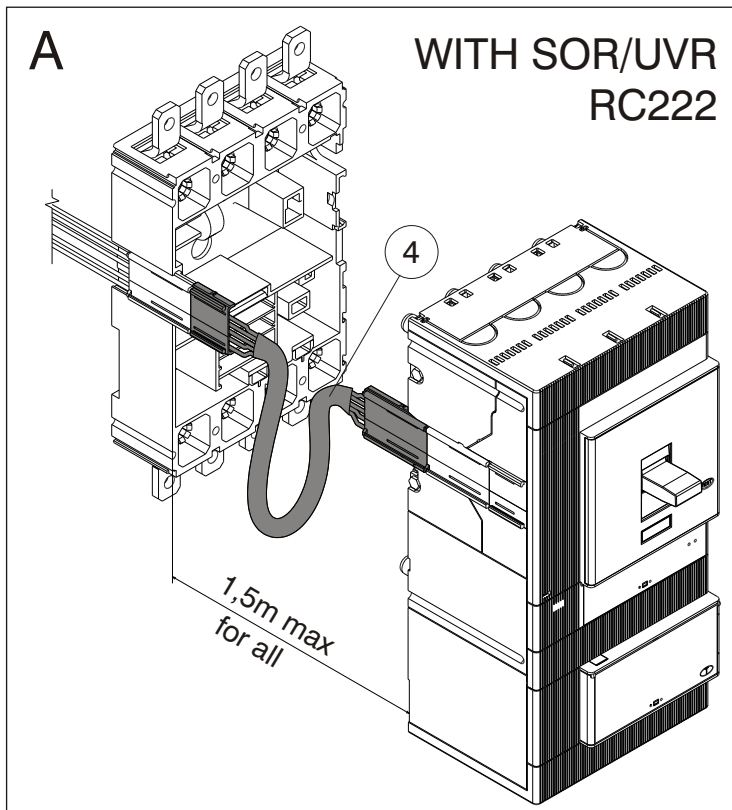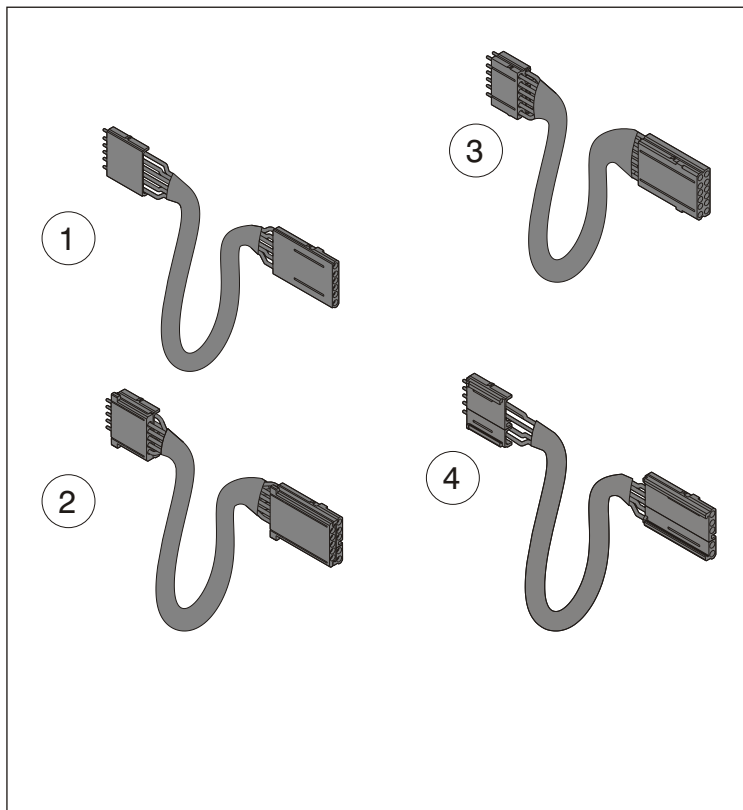


D WITH AUX-C (1+1)
AUX-E

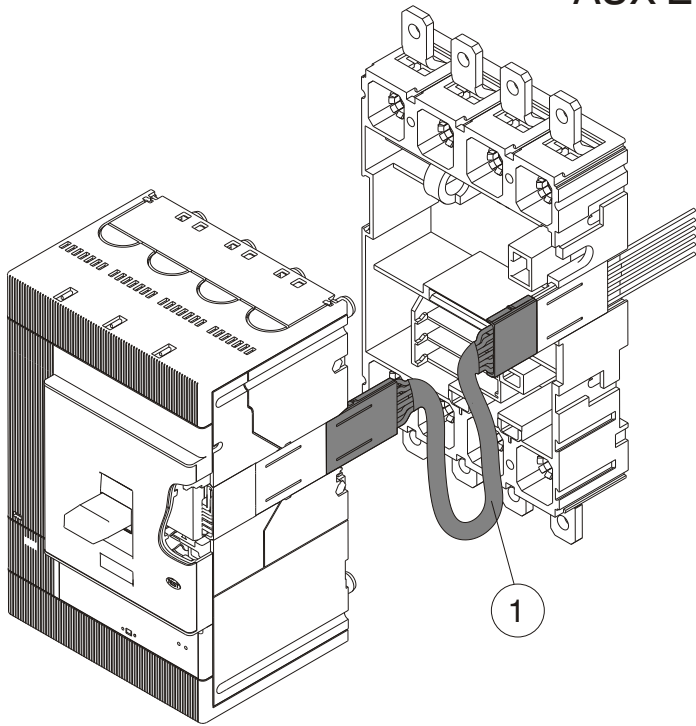

E WITH AUX-C (3+1)

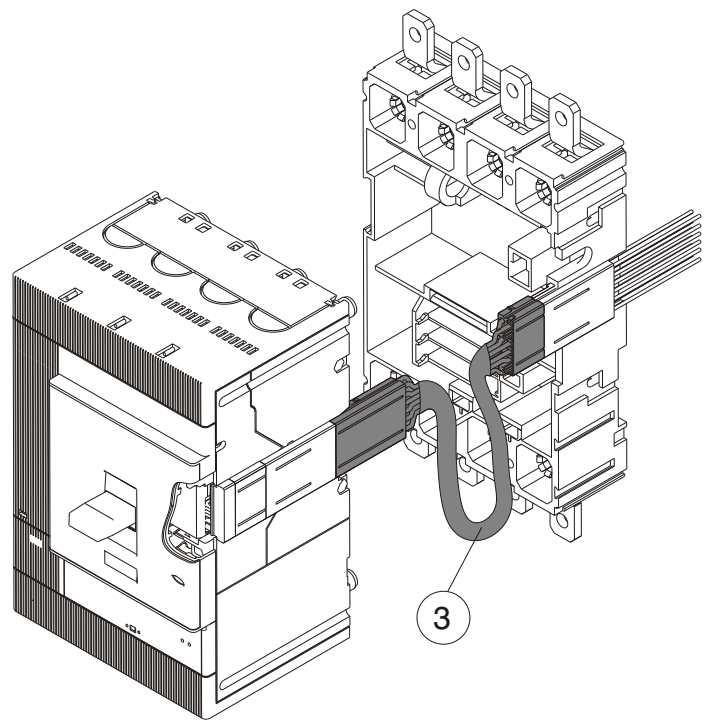

F WITH AUX RC222

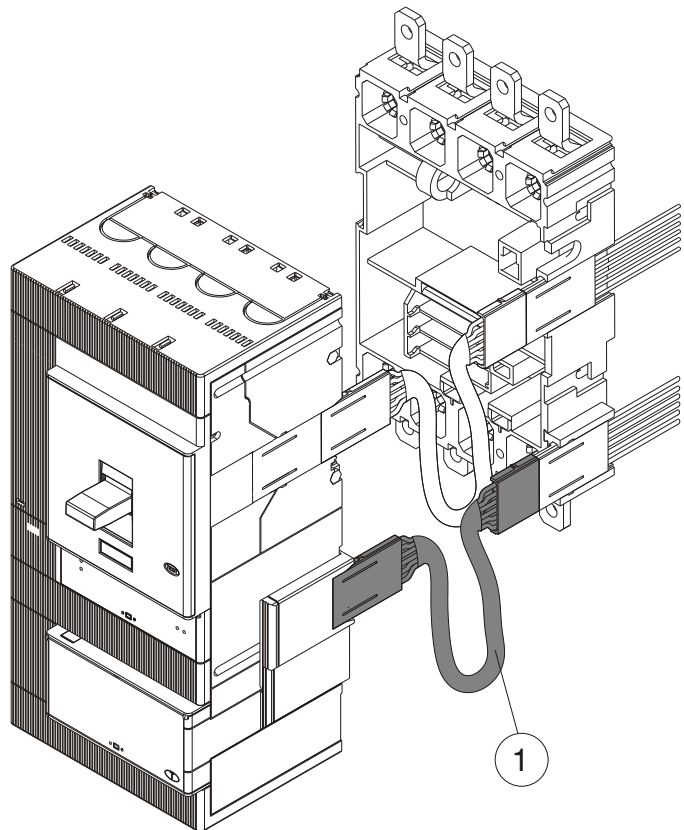

ABB

ABB SACE S.p.A.

Via Baioni, 35
24123 Bergamo Italy

Tel.: +39 035 395.111 - Telefax: +39 035 395.306-433

<http://www.abb.com>