



Blocco a chiave Kirk in posizione di aperto fuori portella
 Kirk key lock for open position outside door
 Schlüssellverriegelung Kirk in Aus-Stellung außerhalb der Schaltfeldtür
 Verrouillage à clé Kirk en position d'ouverture hors porte
 Bloqueo de llave Kirk en posición de abierto fuera de la portezuela

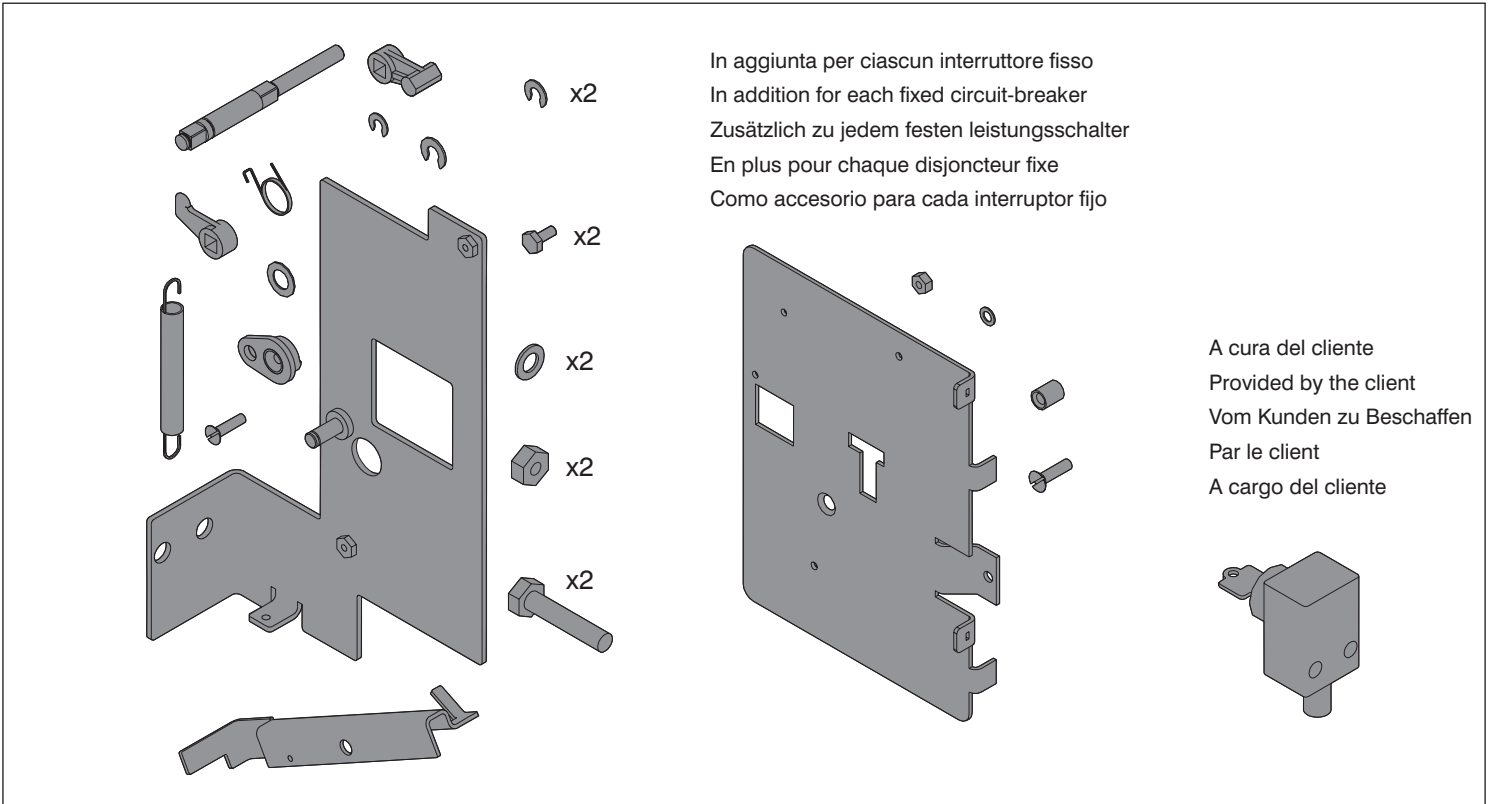


A


Esecuzione estraibile
Steckbare withdrawable
Ausfahrbar
Version débrochable
Ejecución extraíble

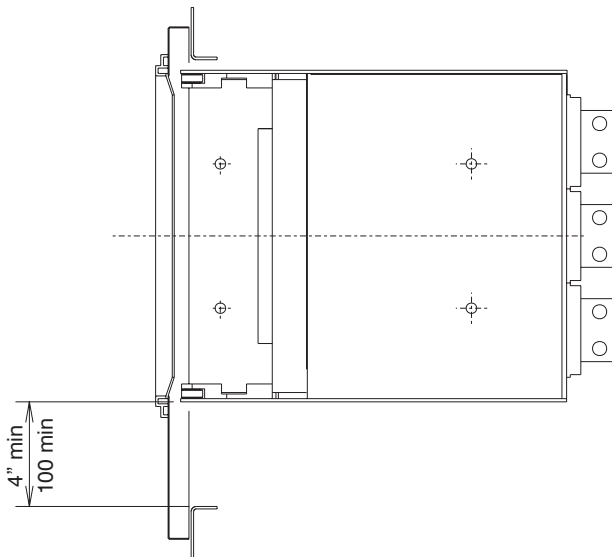

Esecuzione fissa
Fixed version
Feste Ausführung
Version fixe
Ejecución fija

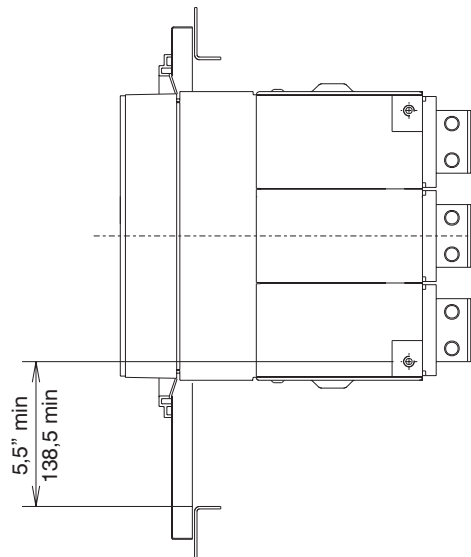


B

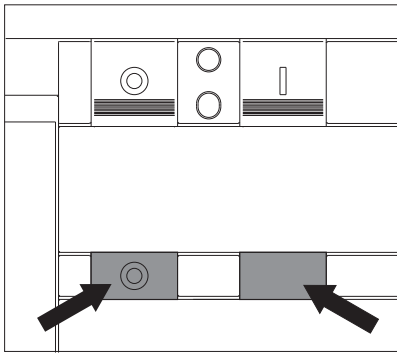

APERTO
OPEN
AUS-STELLUNG
OUVERT
ABIERTO


BIANCO
WHITE
WEISS
BLANC
BLANCO

C

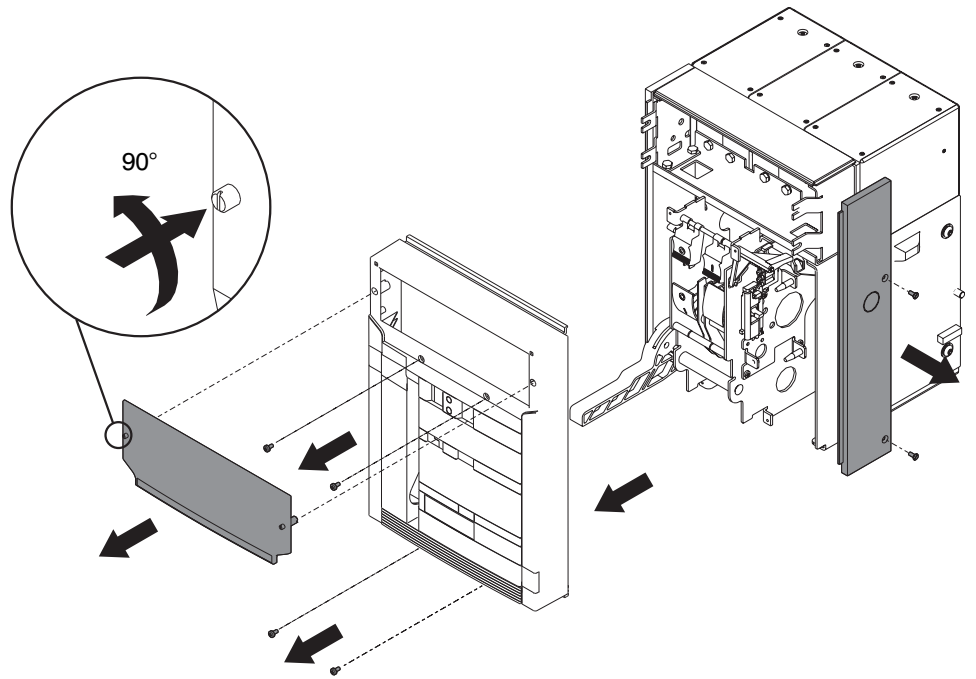


D


Circuit-breaker	A (mm)
E1 III-IV	197.5
E2 III-IV	197.5
E3 III-IV	251.5
E4 III	287.5
E4 IV	377.5
E6 III	377.5
E6 IV	503.5

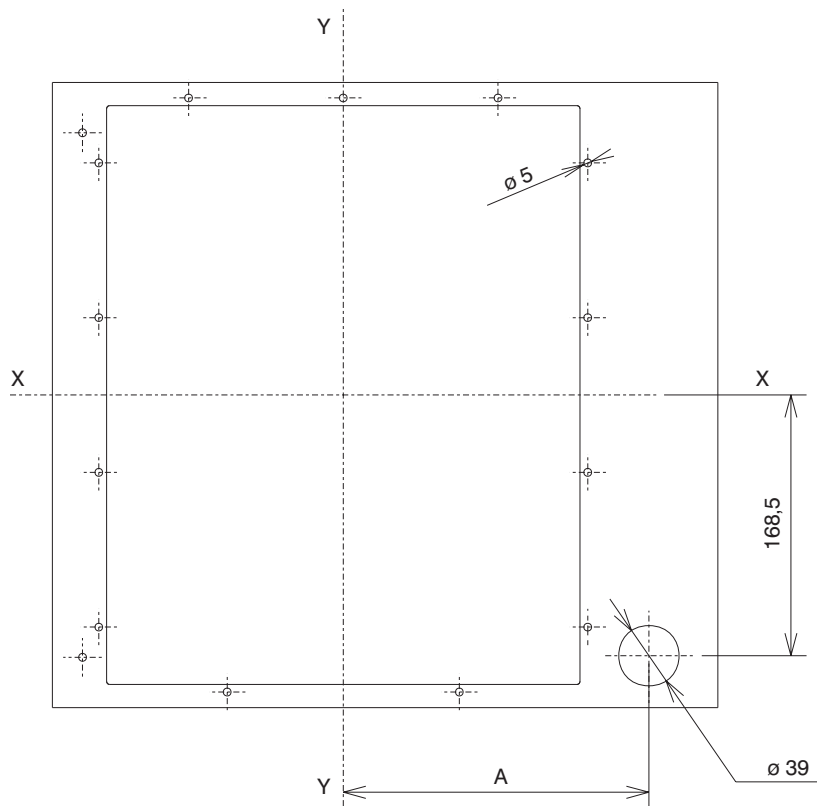


E




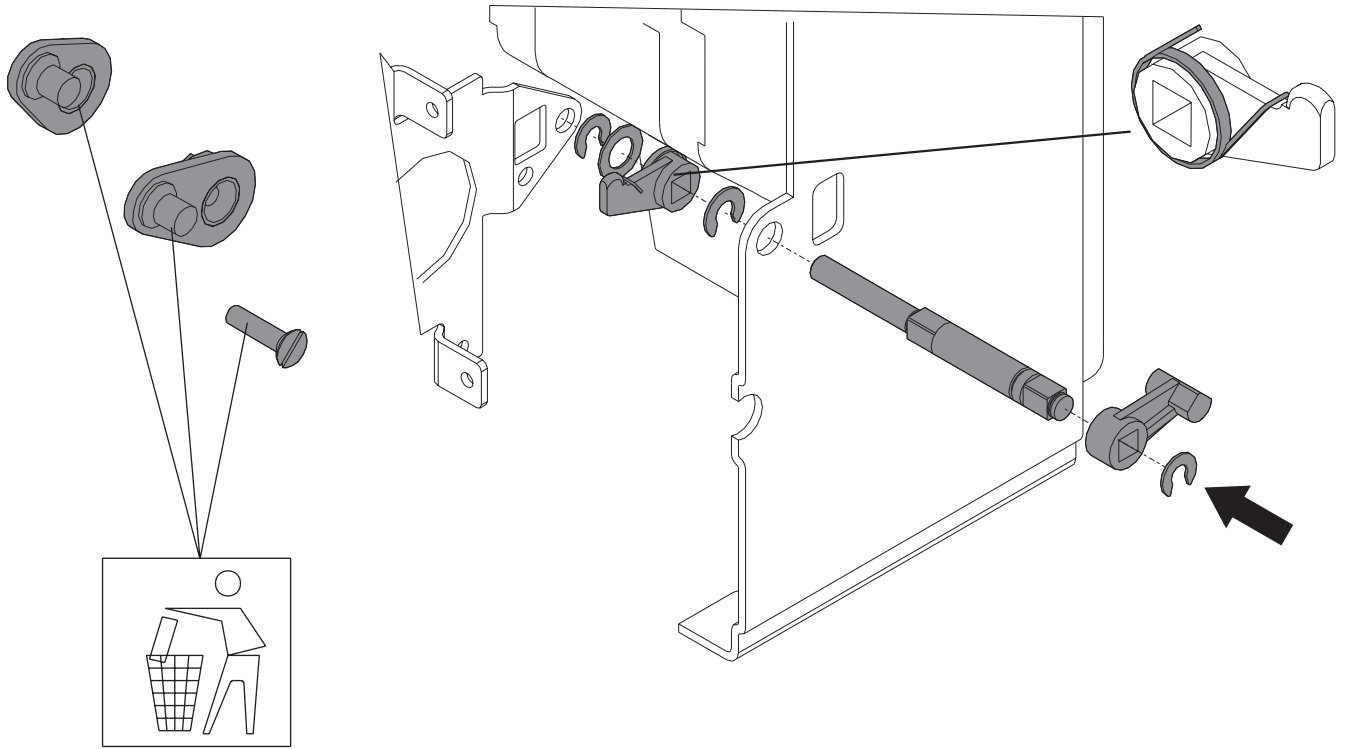


F

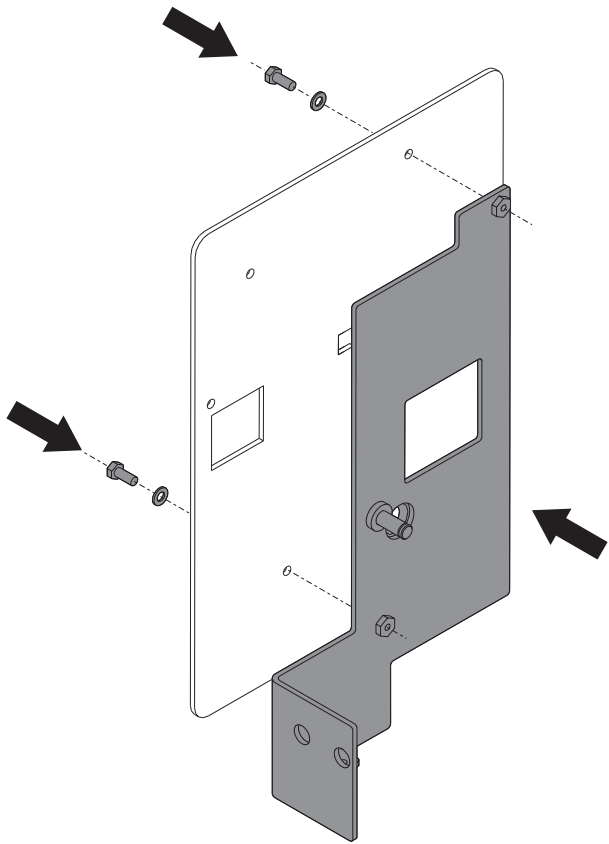

G

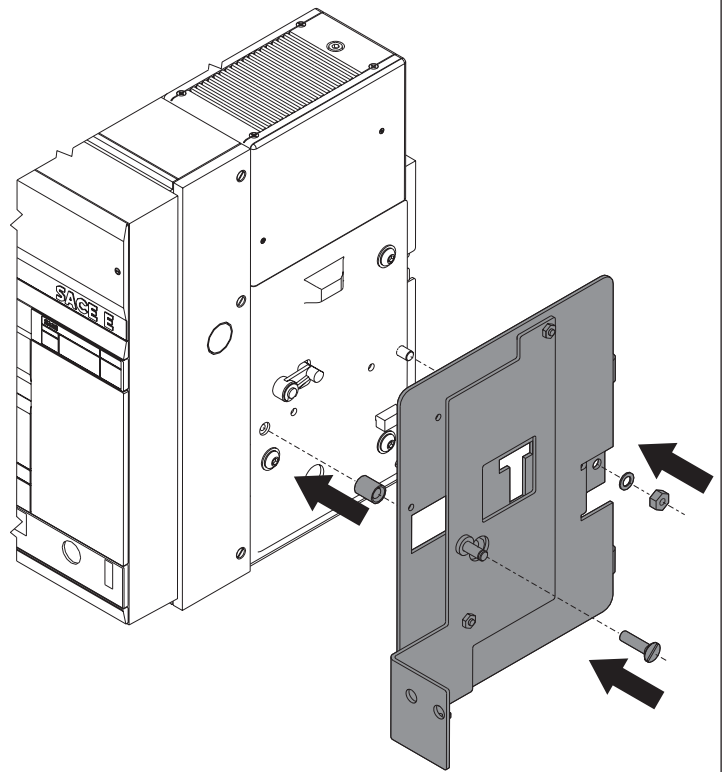

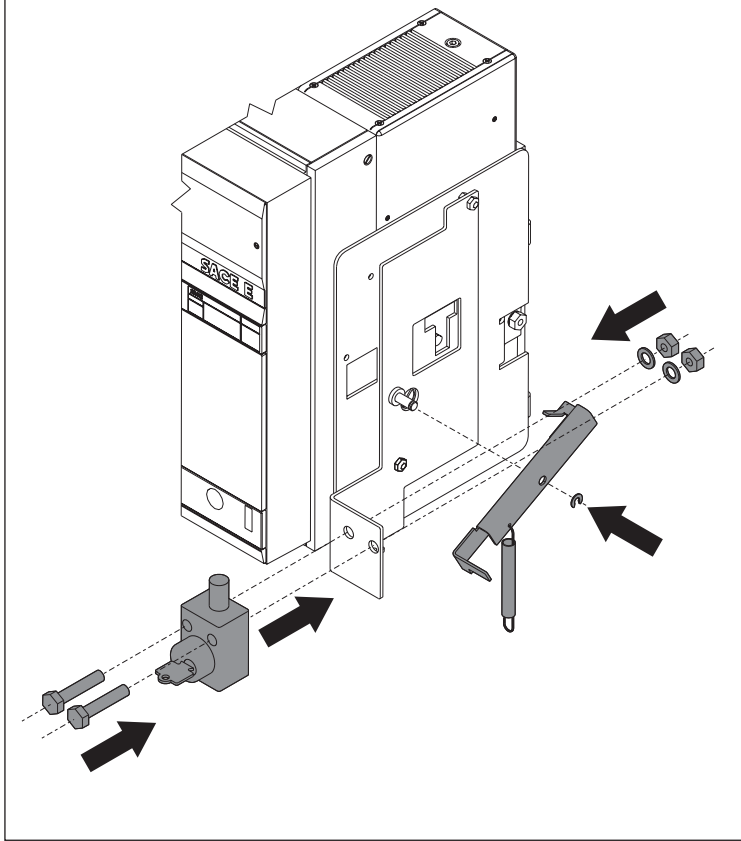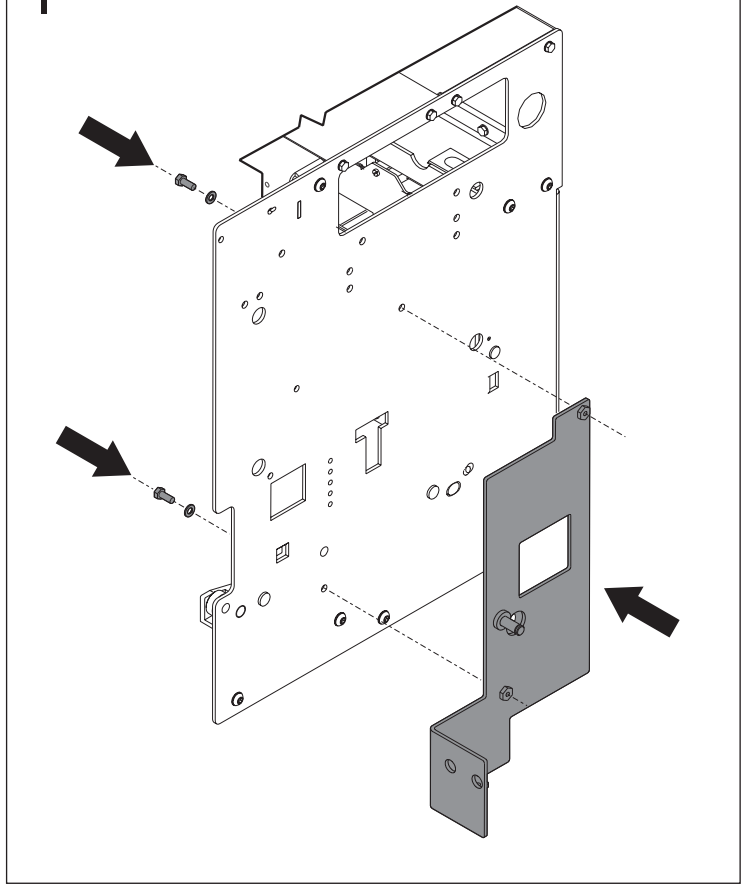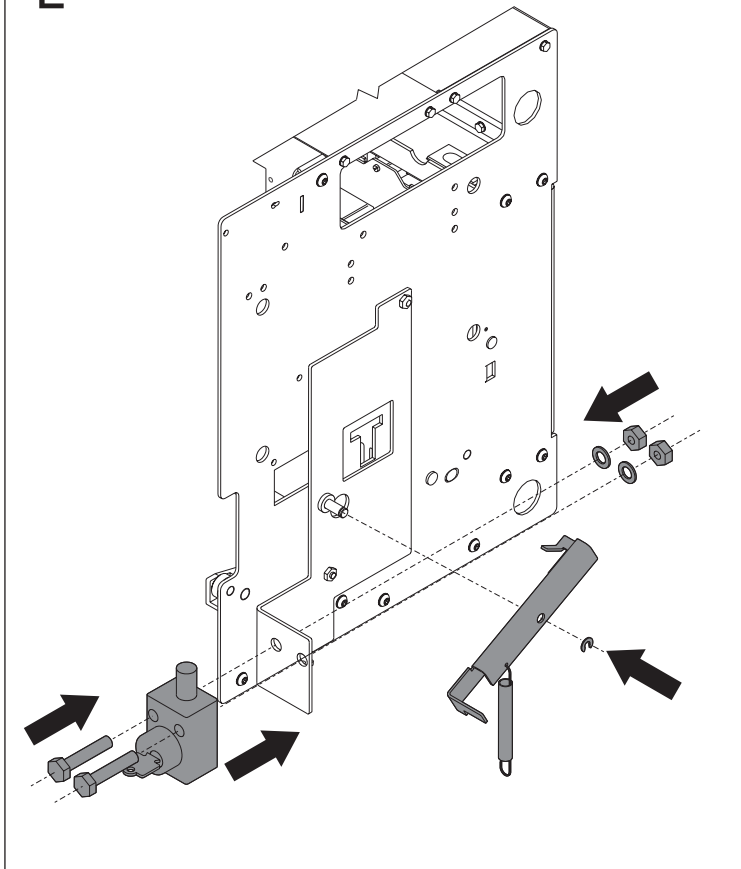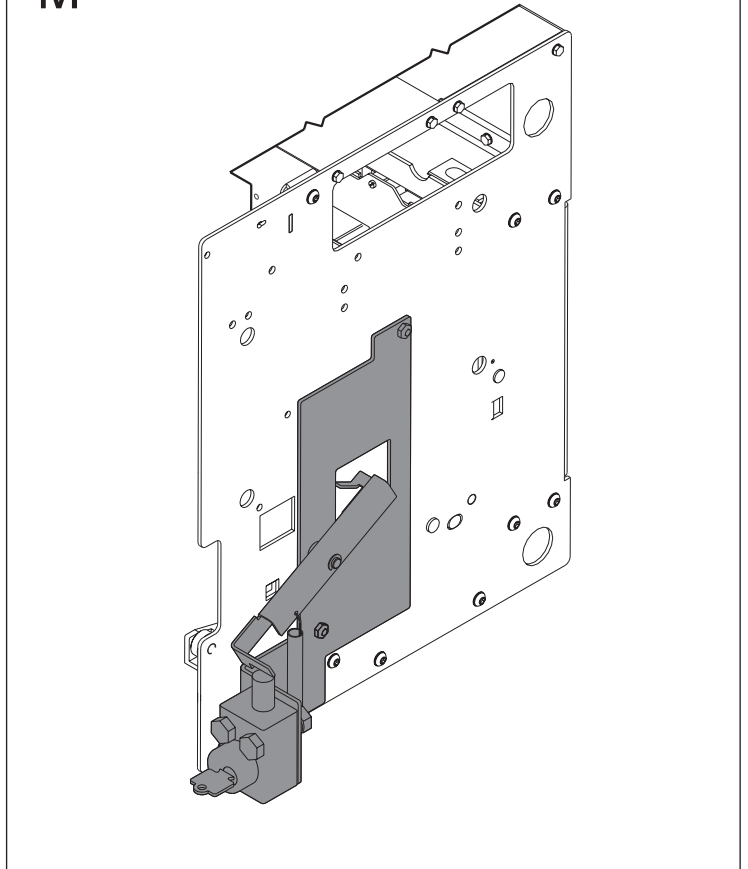H**I****L****M****ABB SACE S.p.A.**

Via Baioni, 35

24123 Bergamo Italy

Tel.: +39 035 395.111 - Telefax: +39 035 395.306-433

<http://www.abb.com>